Meter Collar Adapters Prohibited Installations

(Not allowed – any 320A, puck style, any style using socket adapter, A-base, etc.)

Puck Style:





Sealing Ring Style (May be permitted if neutral connector can safely be connected):







A-base style:


kWh
SANGAMO
K 2 A
320H2121241

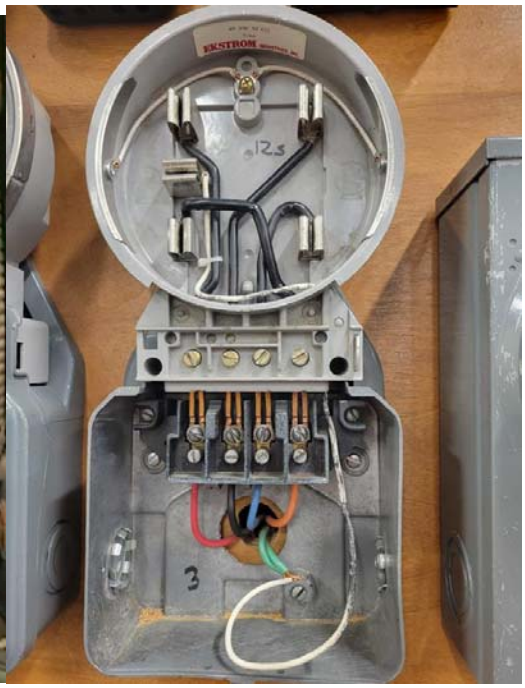


EKSTROM
125
3

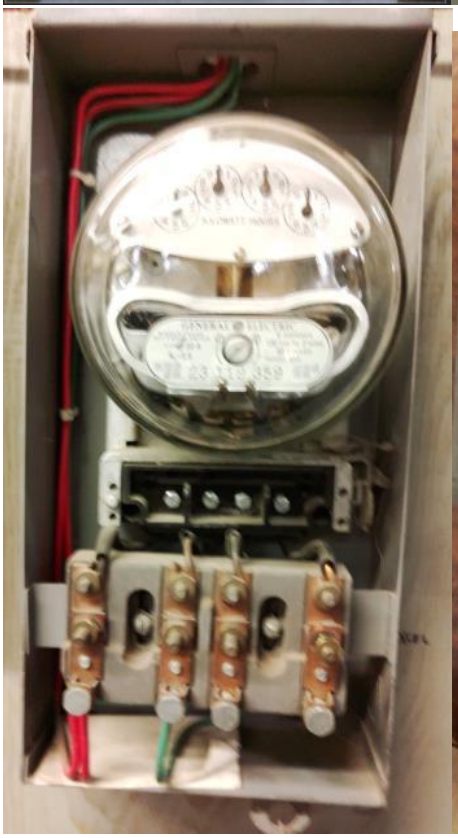


DO NOT
BREAK SEAL
THIS CONNECTION BOX
DOES NOT CONTAIN FUSES

320 Amp self-contained or K-Base style:






Meters already equipped with a socket adapter:





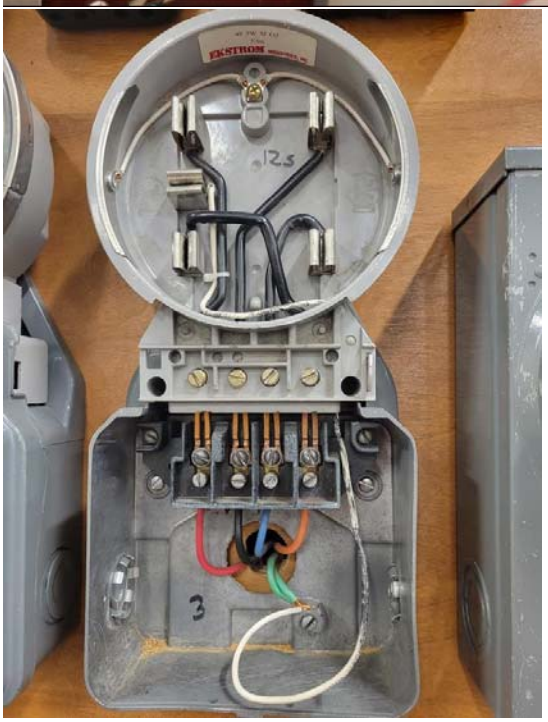

Multi-Gang or Banked meter sockets- Can be approved if conduit and socket adapter does not impede adjacent meter sockets:





Any transformer rated metering using CT’s or CT’s/VT’s:

