Xcel Energy Tier 4 Flow Chart for Interconnecting a Small Generating Facility No Larger than 10 MW

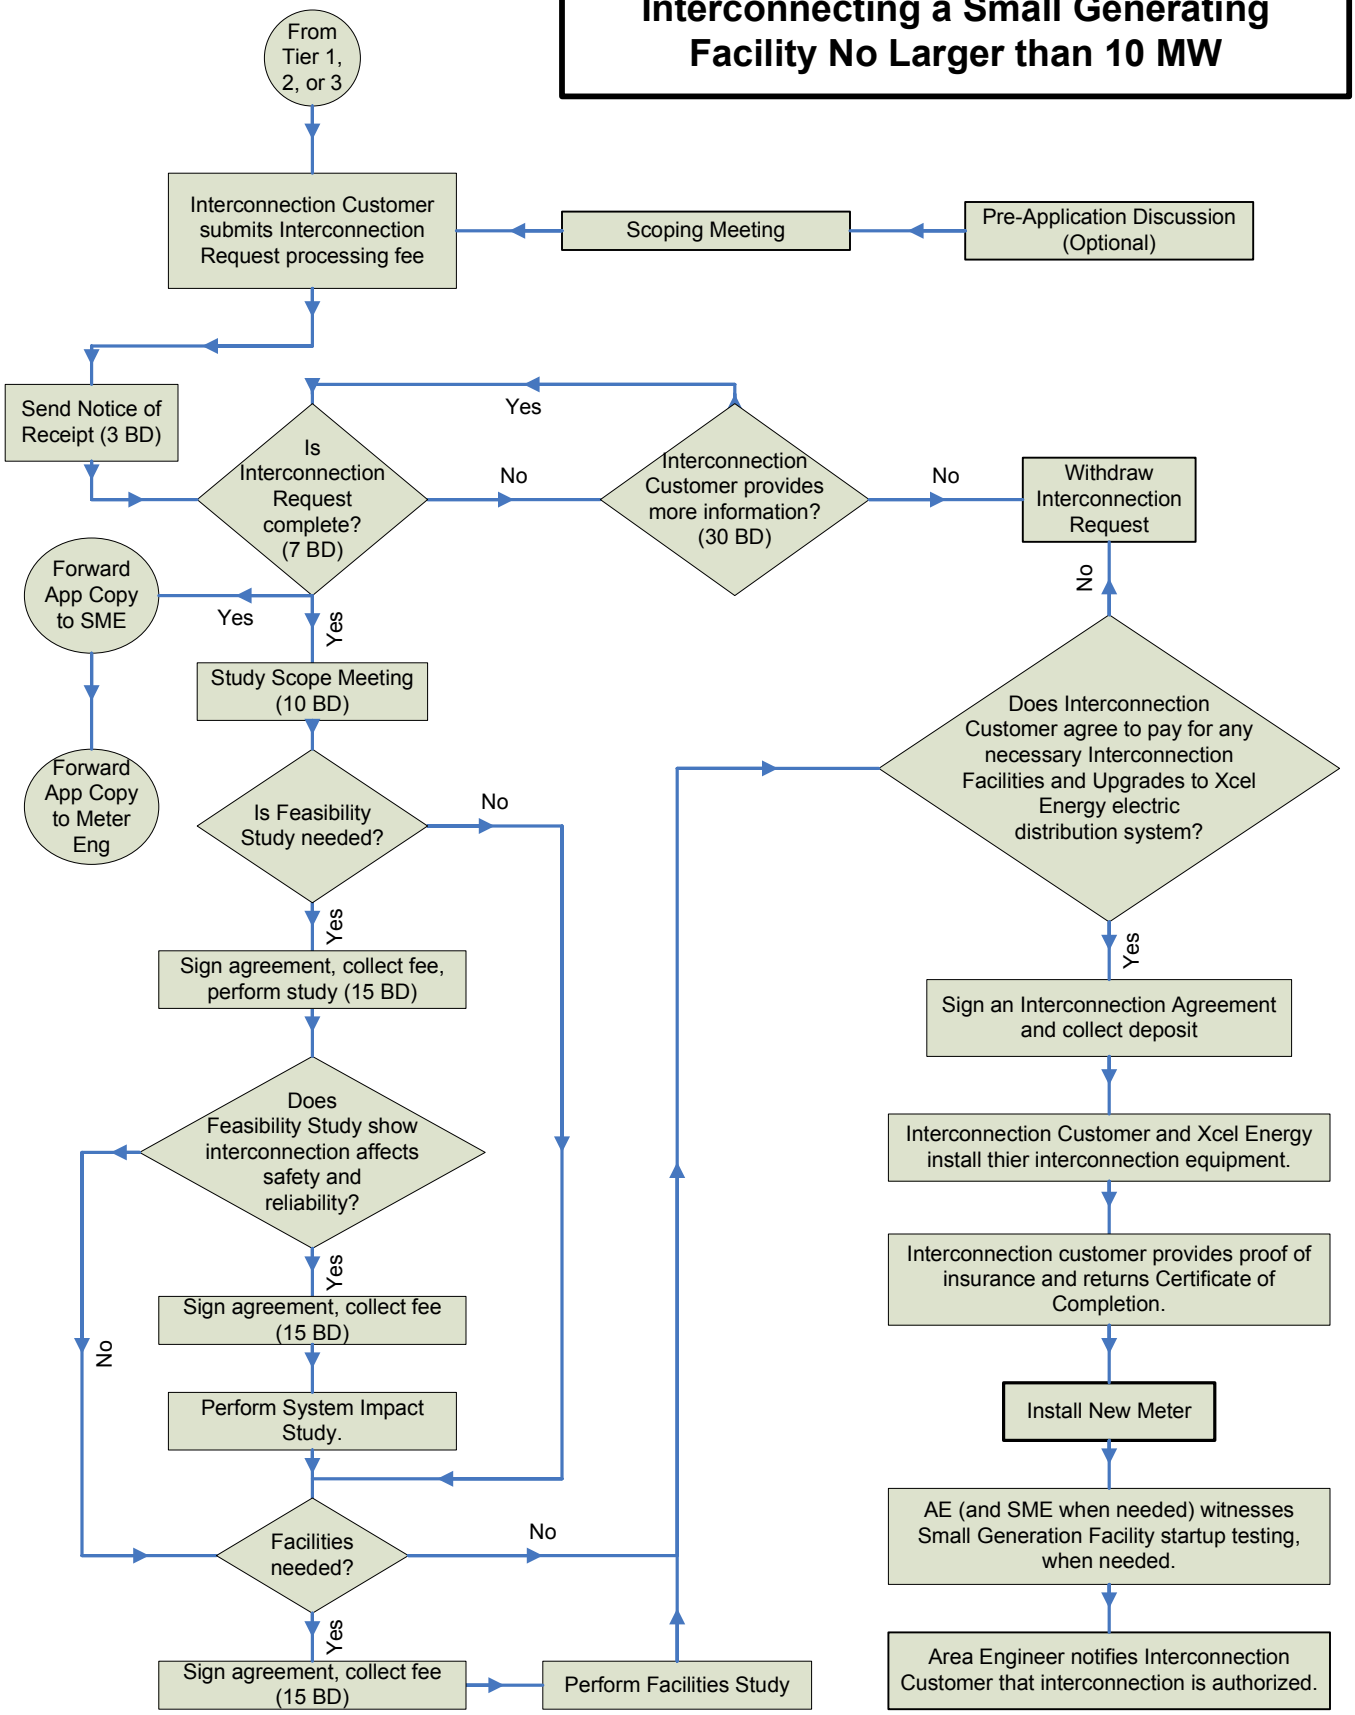

5/5/10 SD Draft